


081220-0900 Pool Water Loss Screening #1

Pump On

Set #3, 12 Aug 2020, 09:24

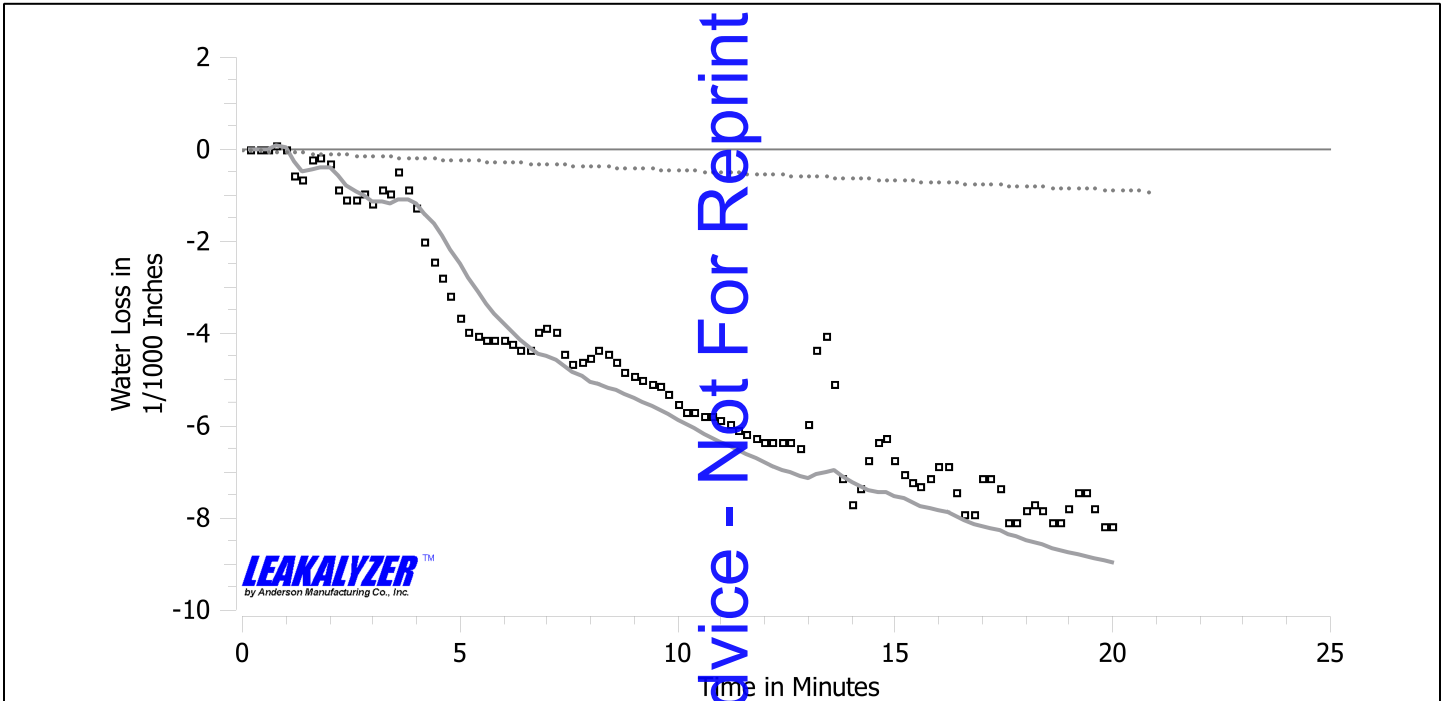

All Data				
	Estimated Rates ($R^2 = 0.904$)			
	in/hr	in/day	gal/hr	gal/day
Total Water Loss	0.025	0.60	6.0	145.1
Estimated Evaporation	0.003	0.06	0.6	15.0
Estimated Leak	0.023	0.54	5.4	130.1

Sample Document Only - Not Legal Advice - Not For Reprint or Use