


081220-0900 Pool Water Loss Screening #2

Pump Off

Set #4, 12 Aug 2020, 09:58

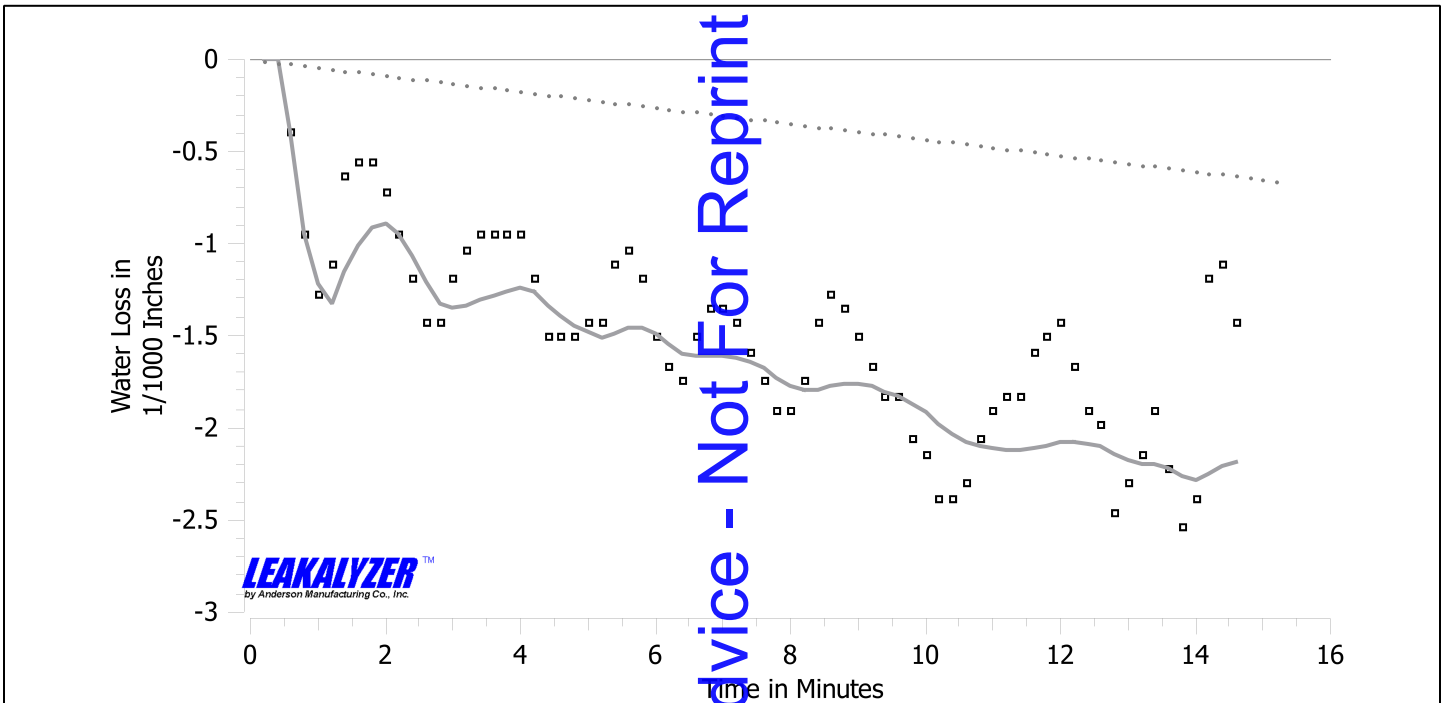

All Data				
	Estimated Rates ($R^2 = 0.579$)			
	in/hr	in/day	gal/hr	gal/day
Total Water Loss	0.006	0.14	1.4	33.9
Estimated Evaporation	0.003	0.06	0.6	15.0
Estimated Leak	0.003	0.08	0.8	18.9

Sample Document Only - Not Legal Advice - Not For Reprint or Use